



Sheet No. 120

Drawn No.

311-M-2

RICHMOND SANITARY DISTRICT
WM. E. ROSS WASTEWATER TREATMENT PLANT
PHASE I IMPROVEMENTS
RICHMOND, INDIANA
AERATION TANKS - BANKS 4-5
PLAN

Project No. 13451

Date 07/31/19

Release 311M-1.DWG

Approved By KEM


Checked By SPG

Drawn By BUS

Designed By KEM

PLAN NOTES:

1. SS 4" DIFFUSER DROP LEG
2. SS 8" DIFFUSER DROP LEG
3. SS 8" DIFFUSER DROP LEG
4. VERTICAL DROP AND HORIZONTAL PIPE TO DISTRIBUTION MANIFOLD SHALL BE STAINLESS STEEL. WHEN TRANSFER PER SPECIFICATION, TYPE OF ALL.

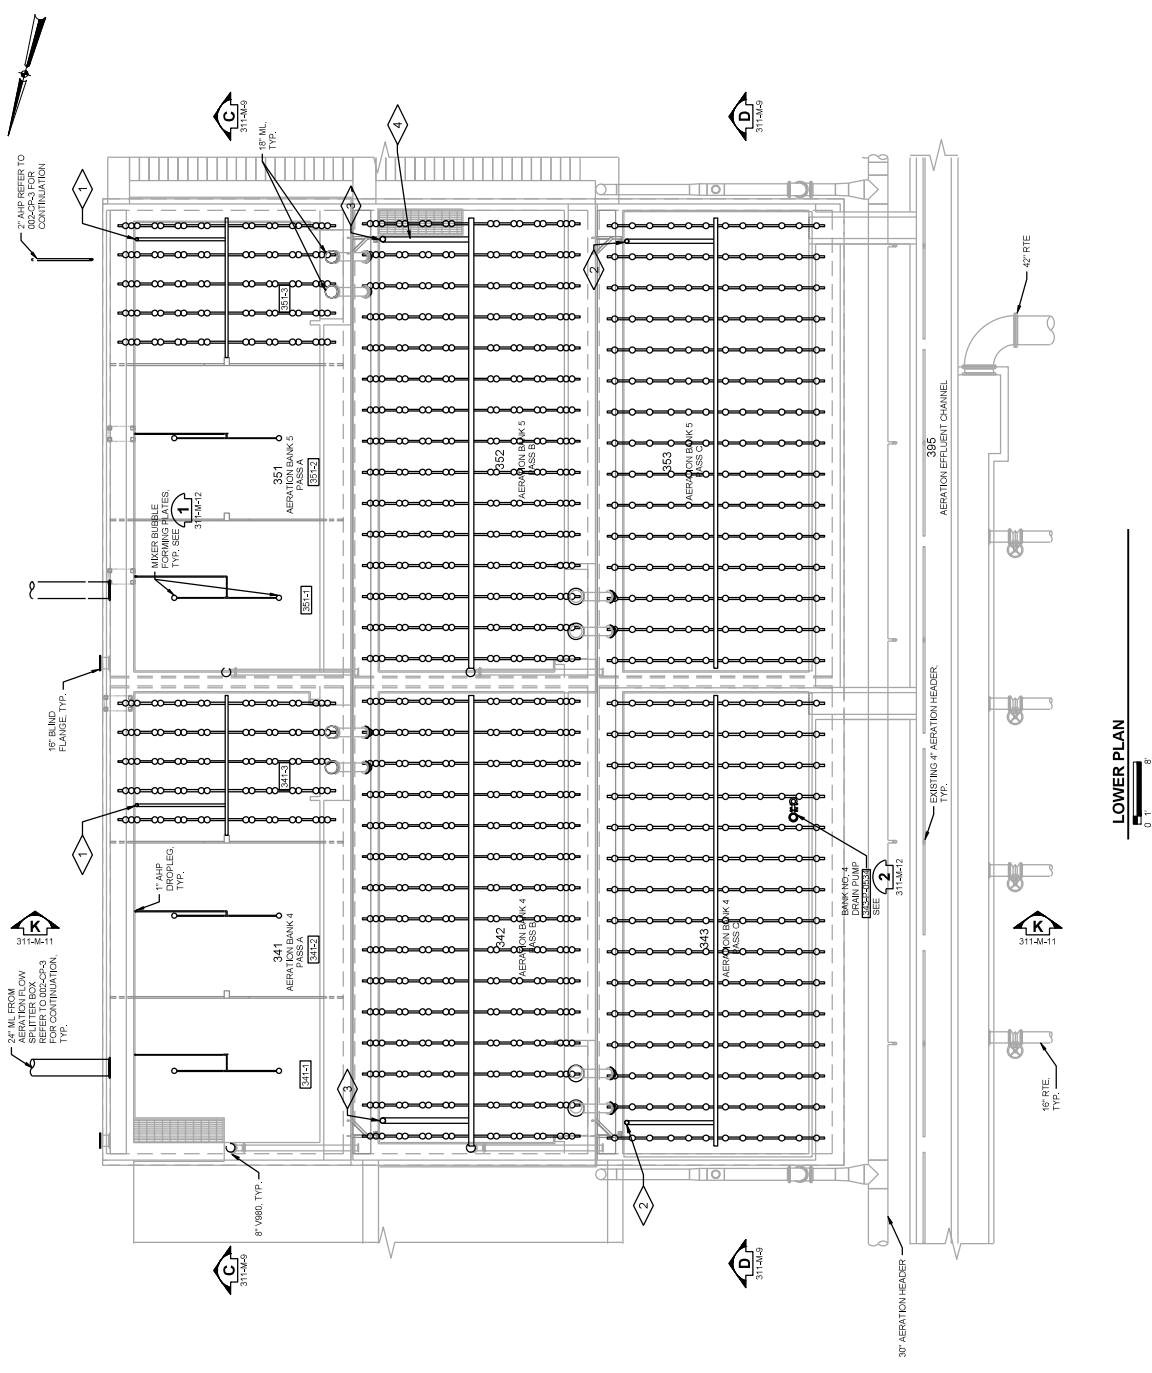

LOWER PLAN
 1" = 10'





DONOHUE
SHEET NO. 121
DRAWING NO. 311-M-3

**RICHMOND SANITARY DISTRICT
WM. E. ROSS WASTEWATER TREATMENT PLANT
PHASE I IMPROVEMENTS
RICHMOND, INDIANA
AERATION TANKS - BANKS 6-7
PLAN**


Project No. 13451
Project Date 07/31/19

Designed By KEM
Drawn By BUS
Checked By SPG
Approved By KEM
Filename 311M-1.DWG

Revision Number	Revision Description	Drawn By	Checked By

PLAN NOTES:

- 1. SS 4" DIFFUSER DROP LEG
- 2. SS 6" DIFFUSER DROP LEG
- 3. SS 8" DIFFUSER DROP LEG
- 4. VERTICAL DROP AND HORIZONTAL PIPE TO DISTRIBUTION MANIFOLD SHALL BE STAINLESS STEEL FOR HEAT TRANSFER PER SPECIFICATION, TYP. OF ALL.

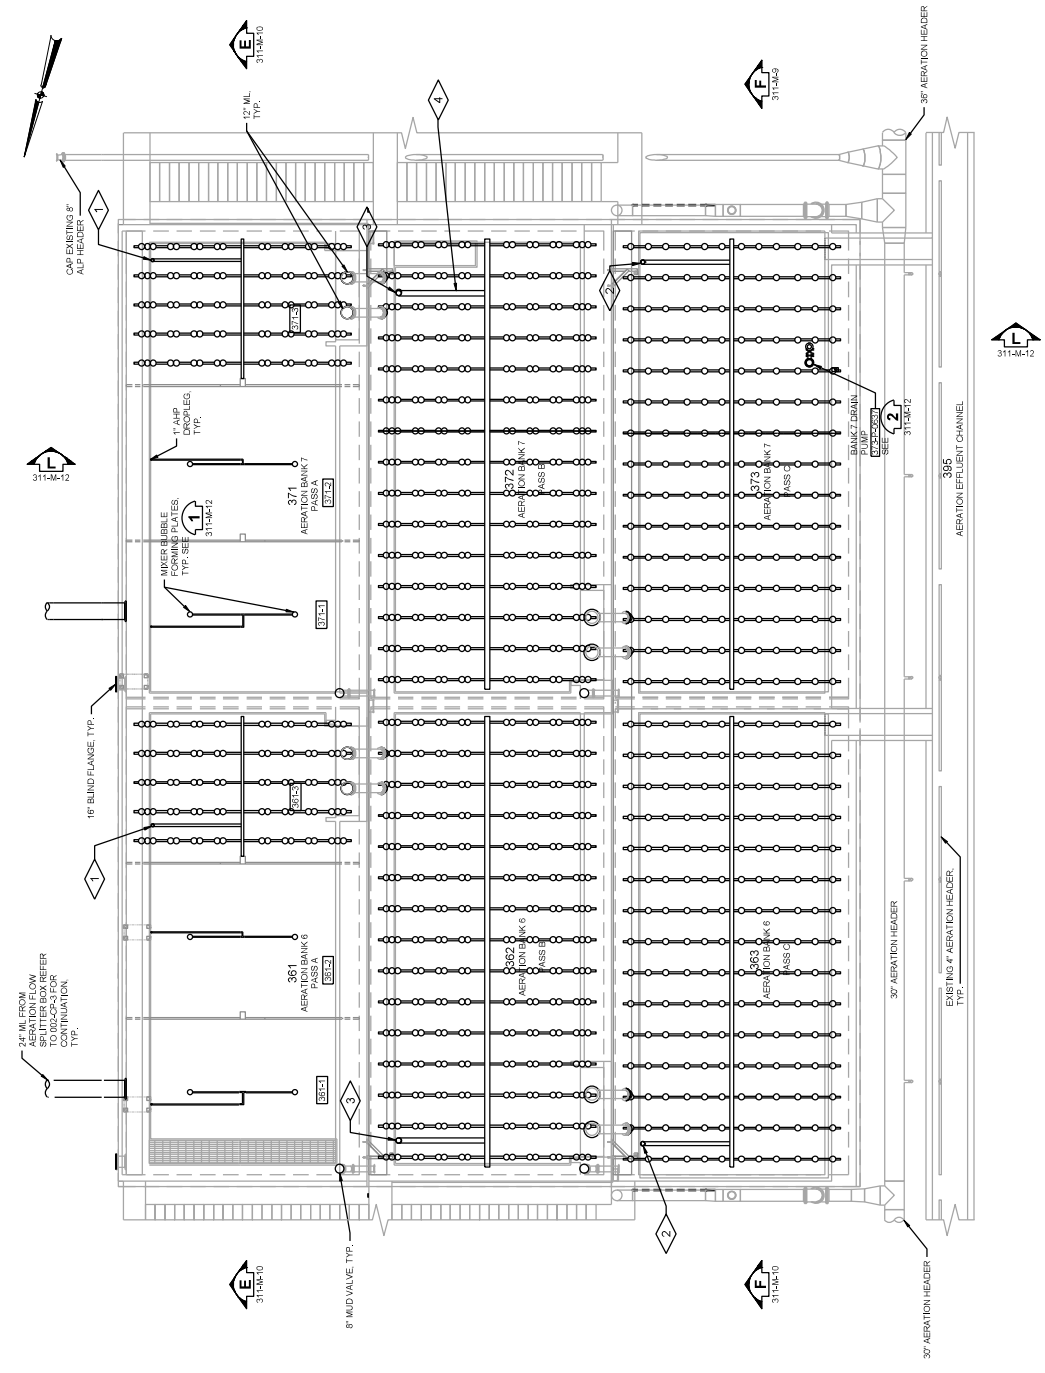

LOWER PLAN
0 1 2 6

